

Article

Day-Ahead Scheduling of Electric Vehicles and Electrical Storage Systems in Smart Homes Using a Novel Decision Vector and AHP Method

Masoud Alilou ¹, Gevork B. Gharehpetian ², Roya Ahmadihangar ^{3,4}, Argo Rosin ^{3,4}
and Amjad Anvari-Moghaddam ^{5,*}

¹ Faculty of Electrical and Computer Engineering, University of Tabriz, Tabriz 5166616471, Iran

² Electrical Engineering Department, Amirkabir University of Technology, Tehran 1591634311, Iran

³ Department of Electrical Power Engineering & Mechatronics, Tallinn University of Technology, 19086 Tallinn, Estonia

⁴ Smart City Center of Excellence (Finest Twins), Tallinn University of Technology, 19086 Tallinn, Estonia

⁵ Department of Energy (AAU Energy), Aalborg University, 9220 Aalborg, Denmark

* Correspondence: aam@energy.aau.dk

Abstract: The two-way communication of electricity and information in smart homes facilitates the optimal management of devices with the ability to charge and discharge, such as electric vehicles and electrical storage systems. These devices can be scheduled considering domestic renewable energy units, the energy consumption of householders, the electricity tariff of the grid, and other predetermined parameters in order to improve their efficiency and also the technical and economic indices of the smart home. In this paper, a novel framework based on decision vectors and the analytical hierarchy process method is investigated to find the optimal operation schedule of these devices for the day-ahead performance of smart homes. The initial data of the electric vehicle and the electrical storage system are modeled stochastically. The aim of this work is to minimize the electricity cost and the peak demand of the smart home by optimal operation of the electric vehicle and the electrical storage system. Firstly, the different decision vectors for charging and discharging these devices are introduced based on the market price, the produce power of the domestic photovoltaic panel, and the electricity demand of the smart home. Secondly, the analytical hierarchy process method is utilized to implement the various priorities of decision criteria and calculate the ultimate decision vectors. Finally, the operation schedule of the electric vehicle and the electrical storage system is selected based on the ultimate decision vectors considering the operational constraints of these devices and the constraints of charging and discharging priorities. The proposed method is applied to a sample smart home considering different priorities of decision criteria. Numerical results present that although the combination of decision criteria with a high rank of electricity demand has the highest improvement of technical and economic indices of the smart home by about 12 and 26%, the proposed method has appropriate performance in all scenarios for selecting the optimal operation schedule of the electric vehicles and the electrical storage system.

Keywords: analytical hierarchy process; decision vector; electric vehicles; electrical storage system; probabilistic model; renewable energy



Citation: Alilou, M.; Gharehpetian, G.B.; Ahmadihangar, R.; Rosin, A.; Anvari-Moghaddam, A. Day-Ahead Scheduling of Electric Vehicles and Electrical Storage Systems in Smart Homes Using a Novel Decision Vector and AHP Method. *Sustainability* **2022**, *14*, 11773. <https://doi.org/10.3390/su141811773>

Academic Editor: Fausto Cavallaro

Received: 22 August 2022

Accepted: 16 September 2022

Published: 19 September 2022

Publisher's Note: MDPI stays neutral with regard to jurisdictional claims in published maps and institutional affiliations.



Copyright: © 2022 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

1. Introduction

Developing new technologies, increasing environmental pollution, and the tendency of utilizing green energies cause growth in the penetration rate of electric vehicles (EVs) in the transportation network [1]. The concept of the smart home (SH) with two-way electricity communication and a smart controllable system facilitates the usage of EVs with vehicle-to-home technology. In a SH, the operation schedule of an EV can be optimized properly for improving its performance [2]. In addition to EVs, the electrical storage system (ESS) is

another useful device that can be used to better match the generation and consumption patterns of SHs [3]. Of course, finding the appropriate charging and discharging times of an EV and ESS based on the availability of the EV, the stored energy of the ESS, the electricity situation of the SH, the market price, and other preferences are very important for improving the efficiency of EVs, ESSs, and SHs [4]. Photovoltaic panels (PVs), which can be placed on a SH's roof or in the unused parts of the yard, act as a domestic renewable energy source affecting the energy situation of the SH and the charging/discharging time of the EV and ESS [5]. The usage of a central management system in a SH for considering various criteria such as the availability of PV power, market price, and electricity demand of the SH is very useful for selecting the proper operation schedule of the EV and ESS [6].

The management of EVs and ESSs has been studied in SHs in the last years. A literature review based on the technologies and economic models of EVs and ESSs has been presented in ref. [7]. In this study, the authors reviewed the relevant literature on business models of EVs and also mentioned key points about each business model. Ref. [8] is another review paper about EVs. The main purpose of this study is the energy storage parts of EVs. In other words, the storage technologies of EVs were studied within the view of eco-friendly and cost-effective purposes. Yang and Zhang presented a review of various types of EVs and the combination of them and different distributed energy sources in ref. [9]. Moreover, different scheduling methods of virtual power plants in the presence of EVs were compared with each other in this study. In Ref. [10], the EV routing problem has been comprehensively reviewed. The definition of the routing problem and the modeling of EVs for solving this problem have been presented in this study, and the developed solution approaches are also pondered. In ref. [11], Kajanova and Bracinik presented a method for controlling the charge time of EVs in a microgrid-connected grid with renewable energy units. The generated power of local renewable energy units is used to charge EVs and also maximize social welfare. The proposed problem was solved using an optimal control method with the model predictive approach. The potential environmental effect of using EV batteries as storage on the energy system as it moves towards the goal of net-zero emissions in 2050 has been evaluated in ref. [12]. This transportation method is a significant step towards a more sustainable energy system to meet climate change mitigation. In ref. [13], a charging and navigation strategy for EVs has been investigated considering the difference in user time utility. The purpose of the proposed method is to find the fastest way for charging EVs. Moreover, it is considered that each vehicle driver can select different navigation routes according to his/her preference. The authors of ref. [14] have presented a component sizing of a series hybrid EVs. The models of the combustion engine, the high voltage battery, and the electric motor have been investigated using experimental information. These experimental data are utilized to produce a robust artificial neural network model for EVs. In ref. [15], a method based on a genetic algorithm has been proposed to find the best location for finding EV charging stations. In the proposed method, the open data sources are analyzed during the optimization. Moreover, an agent-based simulation framework is used around a fleet simulator. The study of energy systems, which is the combination of power generation systems and energy storage systems, has been investigated in ref. [16]. The obtained energy from the power generation system is stored by the ESS to reduce the effect of peak loads on the distribution system. The method for using an ESS has been proposed in ref. [17] in order to mitigate the intermittency of renewable energy units. In this study, the capacity of renewable distributed generation units is selected considering the minimization of the load of the network, while the size and the operational schedule of the ESS is optimized by meta-heuristic algorithm and mixed-integer linear programming. Mehrjerdi and Rakhshani presented a new model of energy storage systems in buildings in ref. [18]. The operational schedule of the ESS is optimized in this study in order to reduce the daily energy cost of the building that is connected to the electrical grid. The mixed-integer binary linear programming method is utilized to solve the proposed energy management program. The utilization of ESS with optimal schedule besides PVs has been investigated in ref. [19] in order to improve the

technical and economic objective functions. Different types of batteries have been studied and evaluated based on techno-economic indices. The authors of ref. [20] proposed a frequency-based energy management method for optimizing the operational schedule of distributed generation units and ESS in a residential microgrid. The reduction in the total energy consumption of the microgrid and the control of the frequency and the peak load of the microgrid are the main purposes of this study that are improved considerably after applying the proposed method. In ref. [21], a review of smart home energy management systems has been presented. The effect of demand response programs on home energy units has been evaluated in this study. A comprehensive scheduling for the day-ahead operation of EVs has been proposed in order to maximize the cost-benefit objective function in ref. [22]. In another study, the management of a residential system in the presence of PVs and ESS has been investigated [23]. In ref. [24], the authors proposed an energy management method for optimal operation of EVs in an SH. The reduction in the effect of the stochastic behavior of renewable energy units on SHs' energy is the main goal of this study. An optimal home energy management method has been proposed in ref. [25] considering home energy sources, ESSs, and EVs. The minimization of the electricity cost and the peak-to-average rate is the purposes of the optimization. In another study, the home energy management system has been investigated in the presence of PVs, ESSs, and EVs in order to minimize the electricity cost, customer dissatisfaction, and the peak-to-average rate [26]. The authors of ref. [27] have proposed a home energy management system based on intelligent algorithms in order to optimize the techno-economic objective functions. The optimal energy management of a residential microgrid has been investigated in ref. [28] in order to increase the efficiency of EVs. The energy management of EVs and ESSs in addition to renewable energy units in the residential microgrids has been studied in refs. [29,30]. In these papers, the authors proposed optimal operational programs in order to increase the performance of the microgrid. In ref. [31], the energy management of multi-microgrids in the presence of SHs has been investigated. The management of EVs and ESSs in the energy hub platform has been studied in refs. [32–34]. The performance of these devices in the presence of demand response programs and local renewable resources has been improved in these papers.

In the mentioned papers, the operational schedule of EVs and ESSs has been achieved separately or simultaneously. In the common scheduling of an EV and an ESS, they are modeled mathematically, and then their charging and discharging times are optimized in order to minimize or maximize technical and economic goals. In this study, we propose a novel approach based on innovative decision vectors and the AHP method to simultaneously optimize the operational schedule of an EV and ESS. In the proposed approach, their charging and discharging times are selected optimally considering the situation of the SH, domestic energy unit, and the economic parameters which are modeled in the new decision vectors. Indeed, in the proposed approach, their operational schedule is selected considering the predetermined vectors without the direct minimization or maximization of economic and technical objective functions. Although the techno-economic indices are only considered for evaluating the approach, their value is reduced after applying the proposed energy management strategy. Moreover, the operational schedule of EVs and ESSs can be achieved using the proposed approach faster than the common methods. So, the current paper presents a novel framework for scheduling the charge and discharge times of EVs and the ESS in an SH. The main highlights of this manuscript are as follows:

- A new approach for the energy management of an EV and an ESS is proposed by considering the PVs, the variable load of the SH, and the electricity tariff.
- A novel decision vector is defined for the charging and discharging of EVs and ESSs based on the market price, the produced power of the PVs, and energy consumption of the householder.
- The analytical hierarchy process (AHP) method is utilized to implement various priorities of decision criteria and to calculate the ultimate decision vectors.

- The optimal operation schedule of an EV and ESS is selected based on the ultimate decision vectors considering the operational constraints of these devices and the constraints of charging and discharging priorities.
- The main aim of the management problem is to minimize the electricity cost and peak demand of SHs during the day.

So, in this paper, the AHP method is utilized to combine the decision vectors of charging and discharging of EVs and ESSs, which are calculated based on the values of market price, the power of the PVs, and the demand of the SH at different times, to select the optimal operation schedule of the EV and ESS. It is worth mentioning that the electricity demand of the SH is variable, and the home buys its required energy from the distribution system with a variable market price. The technical and economic indices are considered for evaluating different priorities and evaluating the performance of the proposed method in selecting the best charging and discharging time for private vehicles and batteries.

2. Proposed Management Method

In this section, firstly, the energy structure of an SH, which consists of the load, PVs, EV, and ESS, is explained. Then, the proposed method for optimally scheduling an EV and ESS is introduced.

2.1. Energy Structure of the SH

The energy of the considered SH can be divided into five parts, including the electricity demand of home appliances, the energy of the PVs, the energy of the EV, the energy of the ESS, and the energy of the distribution system. The overall energy structure of the SH is shown in Figure 1.

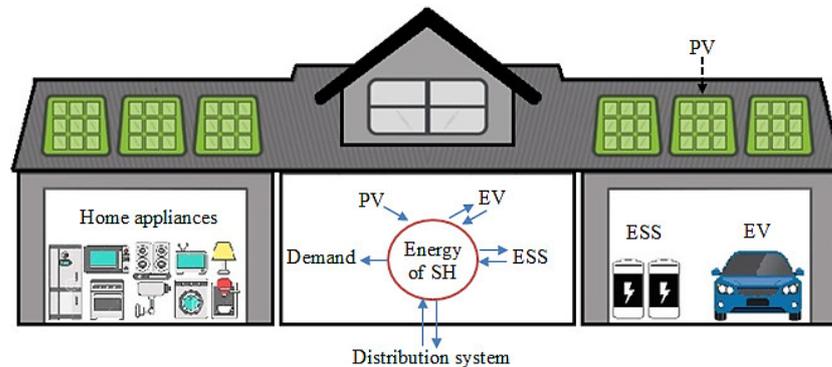


Figure 1. The overall energy structure of the SH formatting.

The total load of the SH is considered in the proposed method. The load is variable during the day. If the power of the PVs is unavailable, the SH buys all required energy from the distribution system with a variable market price. On the other hand, when solar irradiance is available and the PVs generate electricity, the SH buys the extra demand from the distribution system or sells the extra produced power to the distribution system. The produced power of the PVs at each hour (P_{PV}) can be calculated by Equation (1) [4].

$$P_{PV} = \eta_{PV} \times A_{PV} \times r_{si} \quad (1)$$

where η_{PV} and A_{PV} show the efficiency and area of the PVs. r_{si} is the value of solar irradiance. Moreover, it is considered that the PVs is operated with a battery in order to increase the stability and inject the predicted power at each hour.

Another energy part of the SH is related to the hourly power of the EV and ESS. Although the details of the optimal operation schedule of them are explained completely in the next sections, the initial data of the EV and ESS and the method of their calculation are presented here. The initial state of energy (SOE) of the ESS, the initial state of charge (SOC), the departure time of the EV from the parking, and the arrival time to the SH are the

parameters of the EV that are stochastic and variable daily. For this reason, the stochastic model of these parameters is defined using the truncated Gaussian function. Equation (2) is the probability distribution function of the SOE of the ESS, and Equation (3) shows the probability distribution function of the stochastic parameters of the EV [35].

$$p(\text{SOE}) = f_{TG}(X; \mu_{\text{SOE}}; \sigma_{\text{SOE}}^2; x_{\min}^{\text{SOE}}; x_{\max}^{\text{SOE}}) \quad (2)$$

$$p(x) = f_{TG}(X; \mu_X; \sigma_X^2; x_{\min}^X; x_{\max}^X) \quad (3)$$

According to these equations, the probability of each parameter (x) is calculated using its average (μ_X), variance (σ_X^2), minimum (x_{\min}^X), and maximum (x_{\max}^X). The combination of the Latin hypercube sampling algorithm and the K-means method is utilized to calculate the stochastic amount of initial SOE of the ESS, the initial SOC, departure time, and arrival time of the EV.

2.2. Method of Scheduling

In the proposed method, the optimal operation schedule of the EV and ESS is calculated using the decision vector of charging and discharging based on various criteria, including the market price, the produced power of the PVs, and the electricity demand of the SH. The AHP method is used to implement the priority of criteria in selecting the best operation schedule of the EV and ESS. Their constraints are also considered during the management in order to notice the operation conditions of them. Finally, the technical and economical indices are utilized to evaluate the performance of the proposed method and also the different priorities of criteria in the AHP method. The flowchart of the proposed management method of the EV and ESS is demonstrated in Figure 2.

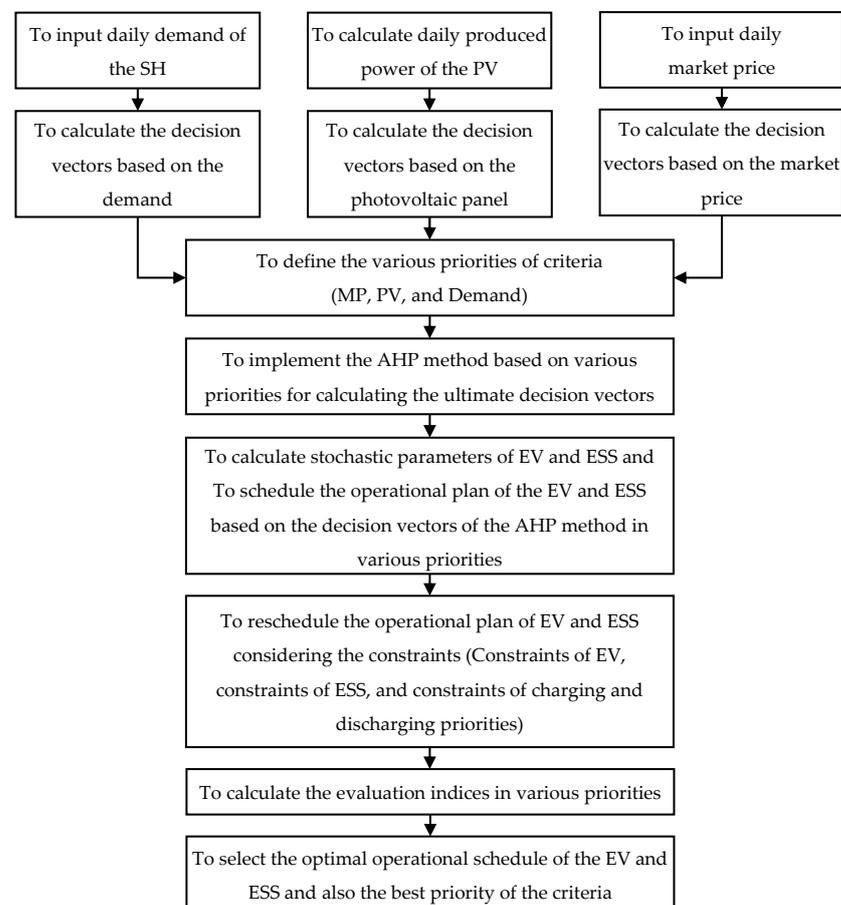


Figure 2. The flowchart of the proposed management method of the EV and ESS.

The method of calculating the decision vectors of the charging and discharging of the EV and ESS based on the various criteria is explained in Section 3. Section 4 is related to the way of implementation of the AHP method. The constraints of the management problem are formulated in Section 5, and the evaluation indices are explained in Section 6.

3. Decision Vectors

In the proposed method, the decision vectors are defined for charging and discharging of the EV and ESS based on the market price, the produced power of the PVs, and the load of the SH.

The daily decision vectors of the charging and discharging of the EV and ESS based on various parameters are defined as follows:

$$DV_C = [c_1, c_2, \dots, c_i, \dots, c_{T-1}, c_T] \quad (4)$$

$$DV_D = [d_1, d_2, \dots, d_i, \dots, d_{T-1}, d_T] \quad (5)$$

In these equations, DV_C and DV_D are the decision vectors of charging and discharging, respectively. c_i shows the desirability rate of charging at hour i , which is a number between 0 and 1. On the other hand, d_i , which has a number between 0 and 1, is the desirability rate of discharging at hour i .

The method of calculating these decision vectors at each hour based on the different parameters is presented in the following.

3.1. Based on the Market Price

In the last years, the variable market price is implemented in the distribution systems in order to encourage end-users to reduce their consumption during peak hours. Based on the market price, it is proper that the EV or ESS charges when the market price is low. On the other hand, the hours with high market prices are the appropriate times for discharging.

Therefore, the desirability of charging has an inverse relation with the market price. In other words, the desirability of charging is increased when the market price decreases. On the other hand, the desirability of discharging, which has a direct relation with the market price, is increased when the market price increases.

Mathematically, the desirability of charging (c_{i_MP}) and discharging (d_{i_MP}) based on the market price is presented in Equations (6) and (7).

$$c_{i_MP} = 1 - MP_{i,pu} \quad (6)$$

$$d_{i_MP} = MP_{i,pu} \quad (7)$$

where

$$MP_{i,pu} = \frac{MP_i}{MP_{max}} \quad (8)$$

Here, MP_i is the market price at hour i and MP_{max} shows the daily maximum market price.

In Figure 3, the hourly desirability of charging and discharging based on the sample market price is demonstrated.

3.2. Based on the Power of the PVs

Domestic PVs are one of the eco-friendly methods for decreasing the dependence of the SH on the energy of the distribution system. Based on the produced power of the PVs, it is reasonable that the EV or ESS charges when the produced power of the PVs is high. On the other hand, the hours that the power of the PVs is low or its power is unavailable are the appropriate times for discharging.

Thus, the desirability of charging has a direct relationship with the produced power of the PVs. In other words, the desirability of charging is increased when the power of the PVs increases. On the other hand, the desirability of discharging, which has an inverse relationship with the power of the PVs, is increased when the market price declines.

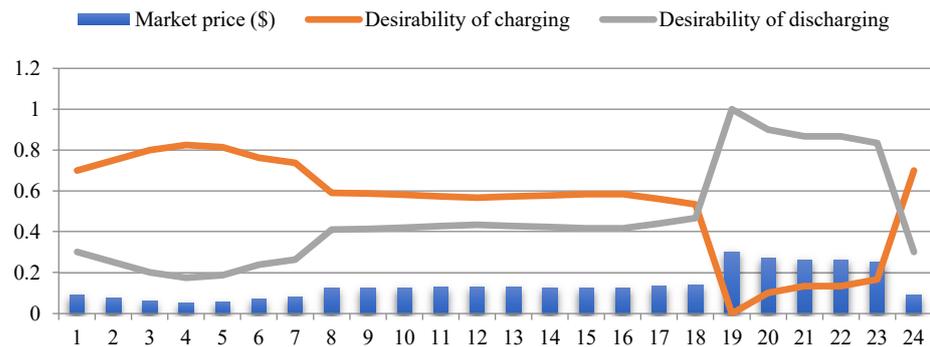


Figure 3. The hourly desirability of charging and discharging of the EV and ESS based on the sample market price.

Mathematically, the desirability of charging (c_{i_PV}) and discharging (d_{i_PV}) based on the produced power of the PVs is presented in Equations (9) and (10).

$$c_{i_PV} = P_{PV_{i,pu}} \quad (9)$$

$$d_{i_PV} = 1 - P_{PV_{i,pu}} \quad (10)$$

where

$$P_{PV_{i,pu}} = \frac{P_{PV_i}}{P_{PV_{max}}} \quad (11)$$

Here, P_{PV_i} is the produced power of the PVs at hour i and $P_{PV_{max}}$ shows the daily maximum power of the PVs.

The hourly desirability of charging and discharging based on the sample produced power of the PVs is shown in Figure 4.

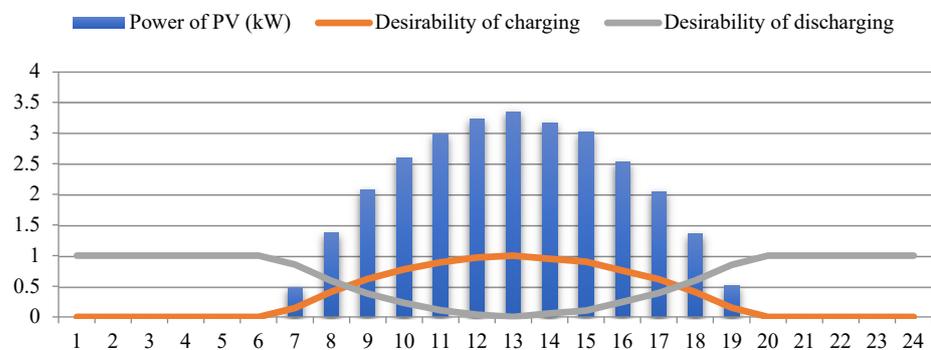


Figure 4. The hourly desirability of charging and discharging of the EV and ESS based on the sample power of the PVs.

3.3. Based on the Load of the Home

Another important subject in the scheduling of the EV is the load of the home. According to the hourly variation of the demand of the SH and considering the hours with low, average, and peak demand, it is reasonable that the EV or ESS are charged during the off-peak times. So, based on the home's electricity demand, it is proper that they charge when the demand is low. On the other hand, the hours with high electricity demand are the appropriate times for discharging.

Therefore, the desirability of charging has an inverse relation with the load of the home. In other words, the desirability of charging is increased when the demand decreases. On the other hand, the desirability of discharging, which has a direct relationship with the load of the home, is raised when the value of the demand increases.

Mathematically, the desirability of charging (c_{i_Demand}) and discharging (d_{i_Demand}) based on the demand of the SH is presented in Equations (12) and (13).

$$c_{i_Demand} = 1 - P_Demand_{i,pu} \quad (12)$$

$$d_{i_Demand} = P_Demand_{i,pu} \quad (13)$$

where

$$P_Demand_{i,pu} = \frac{P_Demand_i}{P_Demand_{max}} \quad (14)$$

Here, P_Demand_i is the electricity demand of the SH at hour i , and P_Demand_{max} shows the daily maximum demand.

In Figure 5, the hourly desirability of charging and discharging based on the sample demand of the SH is demonstrated.

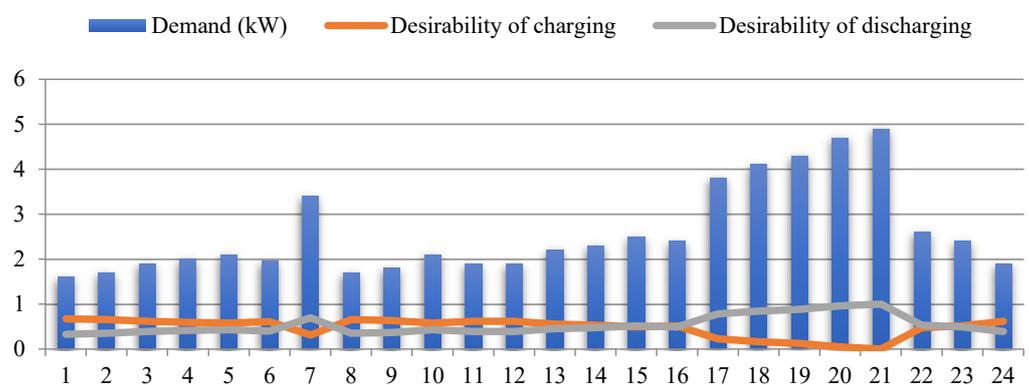


Figure 5. The hourly desirability of charging and discharging of the EV and ESS based on the sample electricity demand.

4. Analytical Hierarchy Process Method

The AHP method is the practical method for selecting the best compromise solution when there are some decision criteria [36]. Although in the proposed management method the best charge and discharge schedule of the EV and ESS can be selected independently based on the mentioned criteria, including the market price, the produced power of the PVs, and the demand of the SH, the AHP method is utilized to select their best operation schedule considering all decision criteria.

The ultimate decision vectors of charging and discharging are calculated using the AHP method after defining initial vectors based on the market price, the produced power of the PVs, and the demand of the SH. In the AHP method, firstly, the judgment matrix is created based on the priority of decision criteria. Then, the arithmetic mean method is used to calculate the final weight of each index (w_i). Finally, the desirability of charging (c_{i_AHP}) and discharging (d_{i_AHP}) at hour i is calculated by Equations (15) and (16) [36].

$$c_{i_AHP} = (w_{i_MP} \times c_{i_MP}) + (w_{i_PV} \times c_{i_PV}) + (w_{i_Demand} \times c_{i_Demand}) \quad (15)$$

$$d_{i_AHP} = (w_{i_MP} \times d_{i_MP}) + (w_{i_PV} \times d_{i_PV}) + (w_{i_Demand} \times d_{i_Demand}) \quad (16)$$

For selecting the best combination or priorities of the mentioned criteria in the AHP method, 13 cases are considered. The priority of the criteria in these cases is presented in Table 1. These cases, which are all possible priorities, are defined in order to select the best case based on the numerical results. In the first three cases, only one decision index is considered; zero (0) means that the criterion is not considered. In other cases, 1 and 3 have the highest and lowest priorities, respectively. The judgment matrix is defined based on the priorities, and then the final weights are calculated using the arithmetic mean method. In Table 2, the judgment matrix and final weight of criteria in various cases are presented.

Table 1. The priority of the criteria in various cases.

Cases	Priority of Each Criterion		
	Market Price	Power of PVs	Demand of Home
1	1	0	0
2	0	1	0
3	0	0	1
4	1	1	1
5	1	2	2
6	1	2	3
7	1	3	2
8	2	1	2
9	2	1	3
10	3	1	2
11	2	2	1
12	2	3	1
13	3	2	1

Table 2. The judgment matrix and final weight of criteria in different cases.

Cases	Judgment Matrix			Final Weight	
		MP	PVs		Demand
1	MP	1.00	0.00	0.00	1.000
2	PVs	0.00	1.00	0.00	1.000
3	Demand	0.00	0.00	1.00	1.000
4	MP	1.00	1.00	1.00	0.333
	PVs	1.00	1.00	1.00	0.333
	Demand	1.00	1.00	1.00	0.333
5	MP	1.00	2.00	2.00	0.500
	PVs	0.50	1.00	1.00	0.250
	Demand	0.50	1.00	1.00	0.250
6	MP	1.00	2.00	3.00	0.545
	PVs	0.50	1.00	1.50	0.272
	Demand	0.33	0.66	1.00	0.181
7	MP	1.00	3.00	2.00	0.545
	PVs	0.33	1.00	0.66	0.181
	Demand	0.50	1.50	1.00	0.272
8	MP	1.00	0.50	1.00	0.250
	PVs	2.00	1.00	2.00	0.500
	Demand	1.00	0.50	1.00	0.250
9	MP	1.00	0.50	1.50	0.272
	PVs	2.00	1.00	3.00	0.545
	Demand	0.66	0.33	1.00	0.181
10	MP	1.00	0.33	0.66	0.181
	PVs	3.00	1.00	2.00	0.545
	Demand	1.50	0.50	1.00	0.272
11	MP	1.00	1.00	0.50	0.250
	PVs	1.00	1.00	0.50	0.250
	Demand	2.00	2.00	1.00	0.50
12	MP	1.00	1.50	0.50	0.272
	PVs	0.66	1.00	0.33	0.181
	Demand	2.00	3.00	1.00	0.545
13	MP	1.00	0.66	0.33	0.181
	PVs	1.50	1.00	0.50	0.272
	Demand	3.00	2.00	1.00	0.545

5. Constraints of Management

5.1. Constraints of EVs

EVs have some constraints that should be considered during the selection of their operating schedule. The constraints are presented in the following.

5.1.1. The SOC of the EV at Departure Time

It is considered that the EV should have been fully charged at the departure time. Equation (17) shows this constraint [36].

$$SOC_{DT} = SOC_{max} \quad (17)$$

Here, SOC_{DT} is the SOC of the EV at the departure time and SOC_{max} is the maximum SOC.

5.1.2. The Limit of Hourly Charging and Discharging

The value of hourly charging and discharging of the EV should be in a range between their minimum and maximum rate. The ranges of hourly charging and discharging are presented in Equations (18) and (19) [36].

$$0 \leq EV_{c_i} \leq EV_{C_{max}} \quad (18)$$

$$0 \leq EV_{d_i} \leq EV_{d_{max}} \quad (19)$$

These equations present that the value of charge (EV_{c_i})/discharge (EV_{d_i}) of the EV should be in the range between zero and the maximum rate of charge ($EV_{C_{max}}$)/discharge ($EV_{d_{max}}$).

5.1.3. The Limit of SOC

It should be considered that the SOC of the EV at hour i (SOC_i) does not violate its range between the minimum SOC (SOC_{min}) and the maximum SOC (SOC_{max}) of the EV according to Equation (20) [36].

$$SOC_{min} \leq SOC_i \leq SOC_{max} \quad (20)$$

5.2. Constraints of ESS

The considered constraints of the ESS during the proposed energy management method are explained in the following.

5.2.1. The Limit of Hourly Charging and Discharging

The value of hourly charging and discharging of the ESS should be in a range between its minimum and maximum rates. The ranges of hourly charging and discharging of the ESS are presented in Equations (21) and (22). In these equations, ESS_{c_i} and ESS_{d_i} are the charged and discharged energy of the ESS at hour i . The parameters $ESS_{C_{max}}$ and $ESS_{d_{max}}$ show the maximum rate of charge and discharge of the ESS at each hour [16].

$$0 \leq ESS_{c_i} \leq ESS_{C_{max}} \quad (21)$$

$$0 \leq ESS_{d_i} \leq ESS_{d_{max}} \quad (22)$$

5.2.2. The Limit of SOE

It should be considered that the SOE of the ESS at hour i (SOE_i) does not violate its range between the minimum SOE (SOE_{min}) and the maximum SOE (SOE_{max}) of the ESS according to Equation (23) [16].

$$SOE_{min} \leq SOE_i \leq SOE_{max} \quad (23)$$

5.3. Constraints of Charging and Discharging Priorities

Three following constraints are also considered in order to find the optimum operational schedule of the EV and ESS.

5.3.1. Inactivity of EV and ESS at the Same Time

It is considered that the performance of the EV and ESS (their charging and discharging actions) should not be at the same time in order to achieve more linear electricity variations of the SH. Mathematically, this constraint can be evaluated by Equation (24).

$$|I_{EV}| + |I_{ESS}| \leq 1 \quad (24)$$

Here, I_{EV} and I_{ESS} show the operation mode of EV and ESS. Their value is -1 , 0 , and 1 when the EV or ESS is in discharge, idle, and charge mode.

5.3.2. Priority of EV in Charging

It is considered that the EV has the priority of charging when the calculated decision vector suggests charge mode for the EV and ESS. Equation (25) shows this constraint.

$$I_{ESS} = 0 \quad \text{if} \quad I_{EV} = 1 \quad (25)$$

5.3.3. Priority of ESS in Discharging

It is considered that the ESS has the priority of discharging when the calculated decision vector suggests discharge mode for the EV and ESS. This constraint is considered by Equation (26)

$$I_{EV} = 0 \quad \text{if} \quad I_{ESS} = -1 \quad (26)$$

6. Evaluation Indices

The technical and economic indices are considered for evaluating the performance of the proposed management method in finding the best operation schedule of the EV and ESS. The electricity cost of the SH is the economic index, and the peak demand is the considered technical index.

6.1. Electricity Cost

For calculating this index, firstly, the hourly power situation of the SH should be calculated by Equation (27).

$$SH_{P_i} = SH_{Demand_i} + SH_{EV_i}m_{EV_i} + SH_{ESS_i}m_{ESS_i} - SH_{PV_i} \quad (27)$$

In this equation, SH_{Demand_i} , SH_{EV_i} , SH_{ESS_i} , and SH_{PV_i} are the demand of the SH, the power of the EV, the power of the ESS, and the produced power of the PVs at hour i , respectively. m_{EV_i} and m_{ESS_i} , which show the modes of the EV and ESS, are equal to $+1$ and -1 when the EV and ESS are in charge and discharge modes, respectively. SH_{P_i} shows the power situation of the SH at hour i .

If the value of the power situation is higher than zero, the SH has to buy electricity from the distribution system. The cost of the bought energy at hour i (Co_i) is calculated by Equation (28). Here, MP_i is the market price at hour i .

$$Co_i = SH_{P_i} \times MP_i \quad \text{if} \quad SH_{P_i} > 0 \quad (28)$$

On the other hand, if the value of the power situation is lower than zero, the SH can sell the extra energy to the distribution system. Equation (29) presents the profit of the sold energy at hour i (Pr_i). Here, tr_i is the tariff of the electricity that the distribution company buys from the end-user at hour i .

$$Pr_i = SH_{P_i} \times tr_i \quad \text{if} \quad SH_{P_i} < 0 \quad (29)$$

Thus, the electricity cost of the SH (EC_{SH}) can be calculated by Equation (30).

$$EC_{SH} = \sum_{i=1}^{24} Co_i + Pr_i \quad (30)$$

where

$$\begin{cases} Co_i = 0 & \text{if } SH_{P_i} < 0 \\ Pr_i = 0 & \text{if } SH_{P_i} > 0 \end{cases} \quad (31)$$

6.2. Peak Demand

Equation (32) is utilized for calculating the peak demand of the SH or the maximum dependence of the SH on the energy of the grid during a day.

$$PD_{SH} = \max_{i=1}^{24} \{SH_{P_i}\} \quad (32)$$

Here, PD_{SH} is the daily peak demand, and SH_{P_i} is the demand of the SH at hour i .

7. Numerical Analysis

In this section, the proposed management method of the EV and ESS is evaluated in a sample SH. It is worth mentioning that the time horizon of the analysis is the day-ahead. The electricity demand of the SH is shown in Figure 6 [37]. The owner of the SH buys its required electricity from the distribution system with a variable market price that is demonstrated in Figure 7. On the other hand, the tariff of the bought energy from the SH by the distribution company is the average of the daily market price [38].

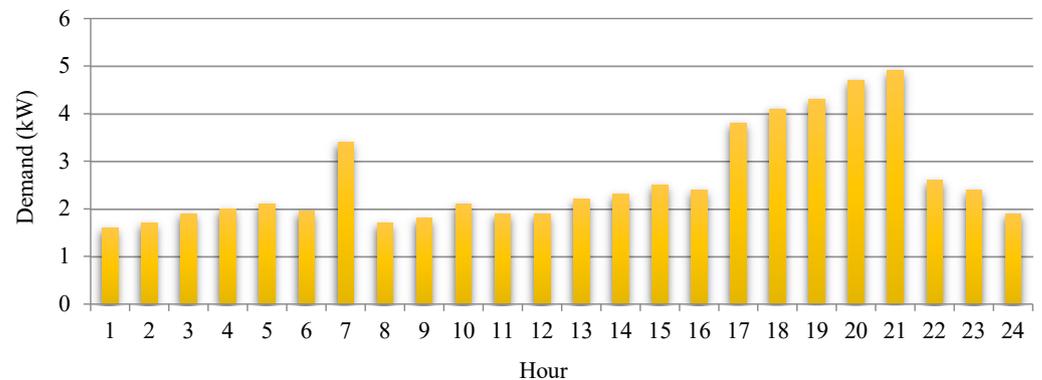


Figure 6. The variation of the electricity demand of the SH.

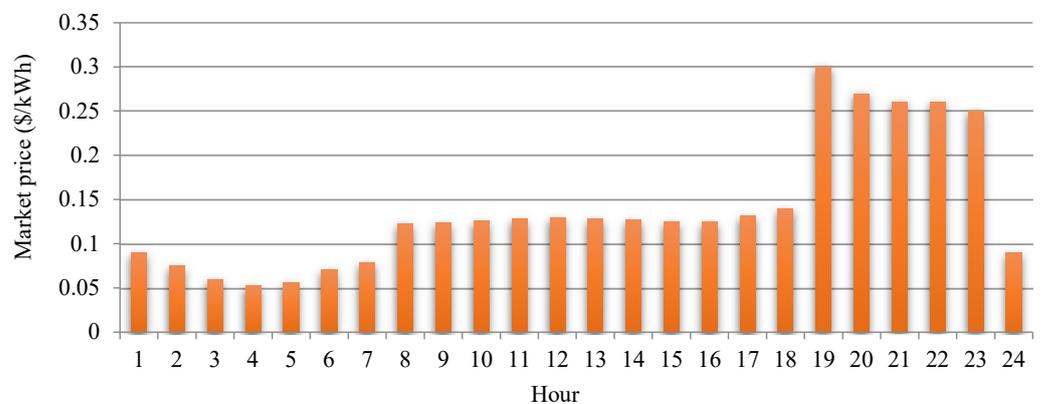


Figure 7. The market price of the distribution system.

It is considered that the SH has the capacity for allocating 10 PVs with the technology of 335 W SolarPower X21. Figure 8 shows the variation of the solar irradiance during the day [39].

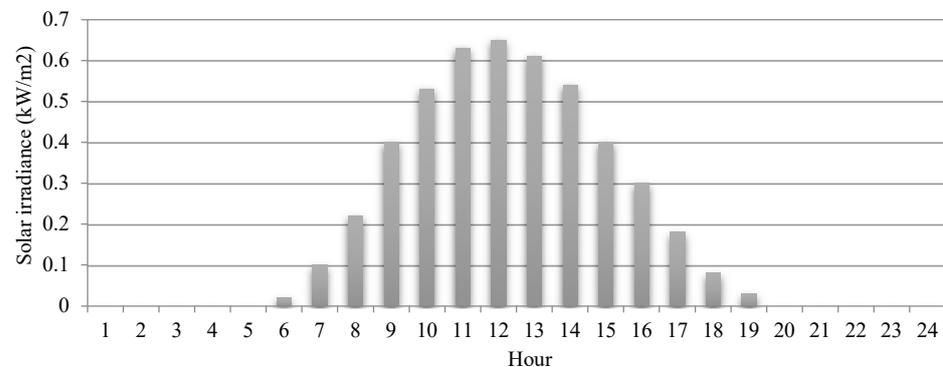


Figure 8. The variation of the solar irradiance during the day.

The type of EV is a CHEVROLET VOLT. The capacity of its battery is 16 kWh. The maximum charge and discharge rate is 3.3 kWh with an efficiency of 95%. It is considered that the EV should be fully charged at the departure time. Moreover, it should not be discharged lower than 30% of its capacity because of the health and longevity of the battery and the welfare of the consumer. The mean values of the initial SOC, departure time, and arrival time are 50%, 8 o'clock, and 19 o'clock, respectively [39].

The total capacity of the ESS is 10 kWh. The charging and discharging efficiency of the ESS is 0.95%. The mean value of the initial SOE of the ESS is 50 percent of the total SOE, while the lower limit of the SOE of the ESS is 20 percent of the total SOE to avoid deep discharging. The hourly charging and discharging limit of the battery of the ESS is 2.5 kW [40].

As mentioned above, firstly, the stochastic parameters of the EV and ESS are calculated by the combination of the Latin hypercube sampling algorithm and the K-means method. According to the results of the probabilistic program, the initial SOE of the ESS is 52.33%, the initial SOC of the EV is 44.73%, and the hours of departure and arrival of the EV are 7 and 19, respectively.

In this step, the decision vectors are calculated using the AHP method considering various preferences of different criteria. As mentioned above (Table 2), 13 cases are considered for evaluating the priorities and selecting the best operation schedule of the EV and ESS. Moreover, the results of the proposed method are also compared with the mentioned method in ref. [41].

The operation schedules of the EV and ESS in different cases are presented in Tables 3 and 4, respectively. In these tables, the positive and negative values show the charging and discharging modes, respectively, while the idle mode is represented by zero. As shown in these tables, the operation times are different based on preferences of market price, availability of PVs, and demand. In cases that the market price has the highest priority, the EV and ESS tend to charge when the market price is low and to discharge when the market price is high. In cases that the demand has the highest priority, they tend to charge when the electricity load of the SH is low and to discharge when the load is high. In cases that the availability of the PVs has the highest preference, the EV and ESS tend to charge when the rate of the produced power of the PVs is high. Of course, because of the EV being out of the home in the middle time of the day, the EV tends to charge at hours that the PVs are available or close to the available times of the PVs. Totally, the charging time of the EV mostly happens during the night, when the market price and demand are low, while the charging time of the ESS mostly happens during midday, when the power of the PVs is available. On the other hand, the ESS can be discharged at the end of the day to reduce the dependence of the SH on the energy of the distribution system. In the following, the performance of different cases, and also the proposed method, are pondered using the results of the evaluation indices.

Table 3. The operation schedule of the EV.

Hour	Power of the EV at Each Hour in Various Cases													Method of Ref. [41]
	1	2	3	4	5	6	7	8	9	10	11	12	13	
1	0.00	0.00	3.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.30	3.30	3.30	2.71
2	0.00	0.00	3.30	2.71	0.00	0.00	0.00	2.71	0.00	3.30	3.30	3.30	3.30	0.00
3	2.71	0.00	2.71	3.30	3.30	3.30	3.30	3.30	2.71	3.30	2.71	2.71	2.71	3.30
4	3.30	0.00	0.00	3.30	3.30	3.30	3.30	3.30	3.30	2.71	0.00	0.00	0.00	3.30
5	3.30	2.71	0.00	0.00	2.71	2.71	2.71	0.00	0.00	0.00	0.00	0.00	0.00	0.00
6	0.00	3.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
7	0.00	3.30	0.00	0.00	0.00	0.00	0.00	0.00	3.30	0.00	0.00	0.00	0.00	0.00
8	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
9	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
13	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
15	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
16	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
22	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
24	3.30	0.00	3.30	0.00	0.00	0.00	3.30	0.00	0.00	0.00	0.00	3.30	0.00	3.30

Table 4. The operation schedule of the ESS.

Hour	Power of the ESS at Each Hour in Various Cases													Method of Ref. [41]
	1	2	3	4	5	6	7	8	9	10	11	12	13	
1	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
2	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
3	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
4	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
5	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	−2.375
6	2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
7	2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
8	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
9	0.000	0.000	2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
10	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
11	0.000	0.000	2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
12	0.000	0.000	2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375	0.000	0.000
13	0.000	2.375	0.000	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	0.000
14	0.000	2.375	0.000	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	0.000
15	0.000	2.375	0.000	2.375	2.375	2.375	2.375	2.375	2.375	2.375	2.375	0.000	2.375	0.000
16	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
17	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
18	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
19	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	−2.375
20	0.000	0.000	−2.375	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	−2.375
21	−2.375	0.000	−2.375	−2.375	−2.375	−2.375	−2.375	0.000	0.000	0.000	−2.375	−2.375	−2.375	0.000
22	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	−2.375	0.000
23	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375
24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	2.375

The hourly power situation of the SH in different cases and based on the proposed method of ref. [41] is demonstrated in Figure 9. In this figure, the SH has to buy electricity from the distribution system with the market price when the value of the power is higher than zero. On the other hand, the owner of the SH sells energy to the distribution system with the predetermined tariff. Thus, the daily electricity cost is calculated using the hourly costs or profits. In Table 5, the amounts of the evaluation indices are presented.

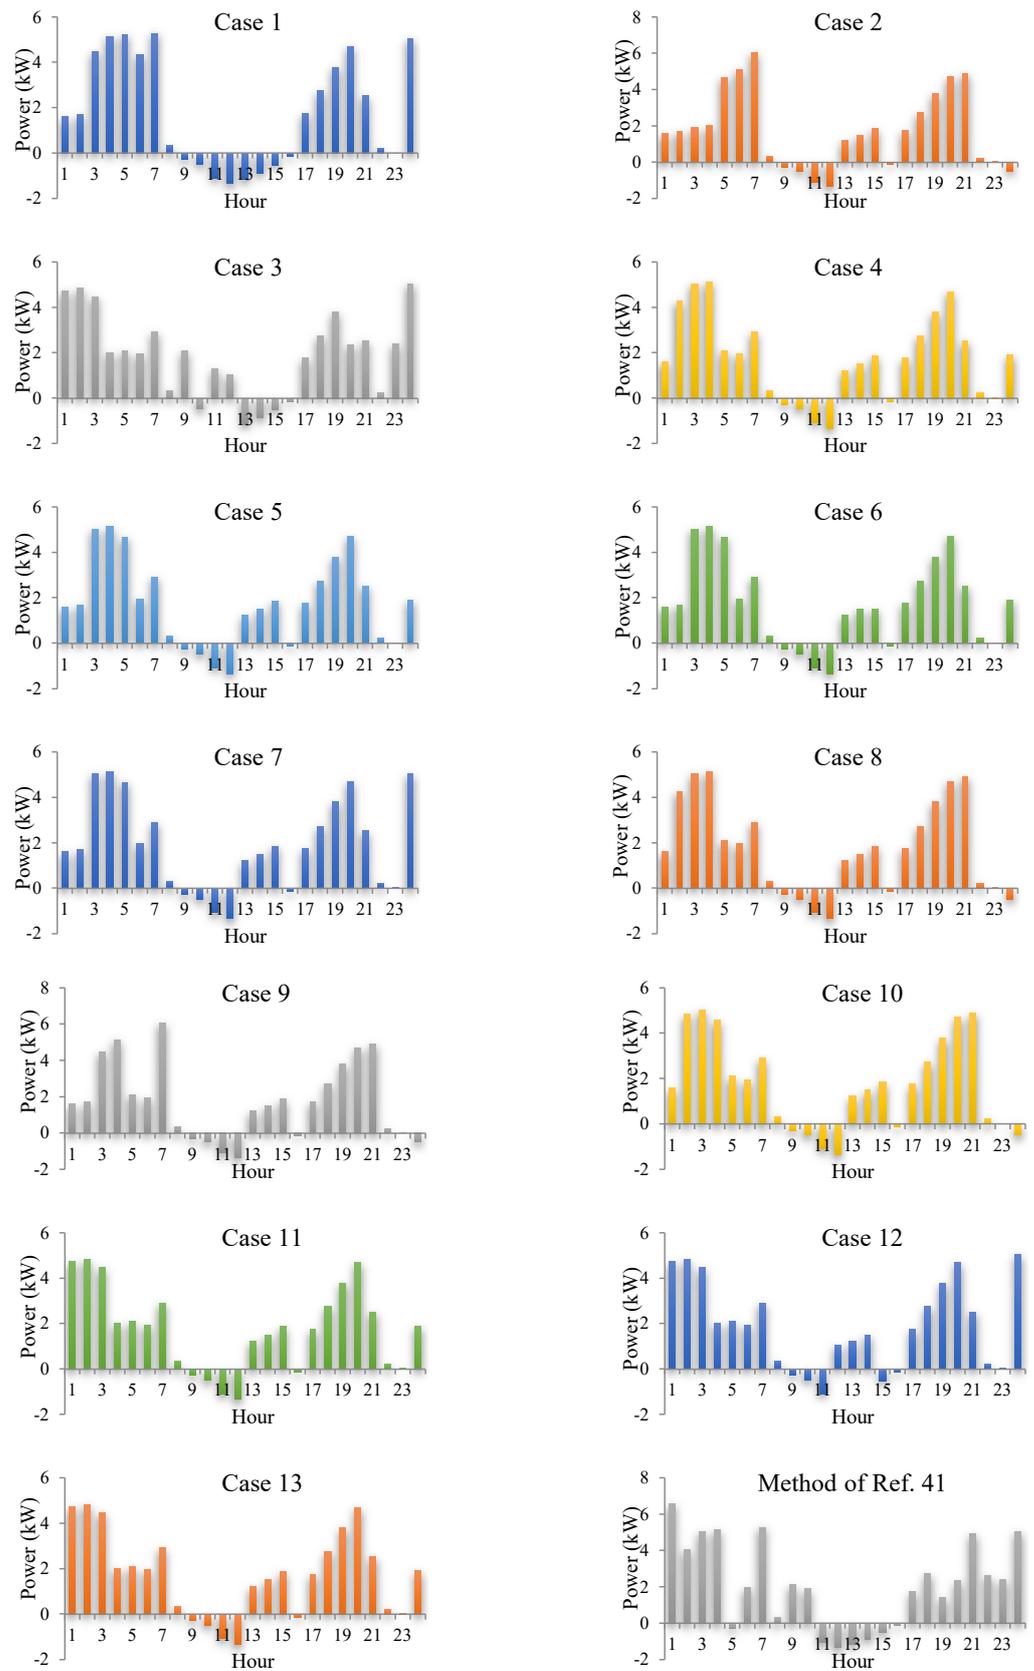


Figure 9. Hourly power situation of the SH.

Table 5. The value of evaluation indices of the SH.

Cases	Evaluation Index	
	Electricity Cost (USD)	Peak Demand (kW)
1	5.654	5.288
2	6.048	6.048
3	5.960	5.035
4	5.597	5.135
5	5.549	5.135
6	5.549	5.135
7	5.831	5.135
8	5.978	5.135
9	5.998	6.048
10	5.991	5.035
11	5.723	4.835
12	6.022	5.035
13	5.723	4.835
The method of Ref. [41]	6.489	6.548

In cases where only one decision criterion is considered (Cases 1–3), case 1 has the lowest electricity cost, while case 3 has the lowest peak demand. This difference is because of the different decision vectors. Cases 5 and 6 have the lowest electricity cost, with USD 5.549, and cases 11 and 13 have the lowest peak demand, with 4.83 kW. For selecting the best case, the AHP method is utilized again. In this step, the weight of each evaluating index (electricity cost and peak demand) is considered equal to 0.5. Therefore, cases 11 and 13 are selected as the best combination state of the decision criteria. In this case, the peak demand of the SH is 4.835 kW, while the daily electricity cost is USD 5.723. It is worth mentioning that, in these cases, the demand has the highest priority.

The considered cases are also pondered based on different points of view. The owner of the SH has a different view than the owner of the distribution system about the operational schedule of the EV and ESS. The lowest electricity cost is the most important subject for the owner of the SH. So, based on the consumer's point of view, the operational schedules of the EVs and ESSs in cases 5 and 6 with the lowest electricity cost are the best results. On the other hand, cases 11 and 13, with the lowest peak demand, are the proper results based on the producer's point of view.

The electricity cost and peak demand of the SH after utilizing the method of ref. [41] are USD 6.489 and 6.548 kW, respectively. So, according to the results of the case 13 (also case 11) as the best result, the proposed management method reduces the electricity cost by about 11.79% and improves the peak demand by about 26.16% more than ref. [41]. Although the proposed method is utilized for day-ahead management, and the running time of the program is not so important, the proposed method is much faster than the other method. The running time of the proposed method is 0.07802 s, while the running time of the method in ref. [27] is 29.686587 s. Thus, the proposed method finds the best operation schedule of the EV and ESS about 99.74% sooner than ref. [41]. Therefore, the proposed method has proper performance in selecting the optimal operation schedule of EVs and ESSs in SHs for improving the technical and economic indices of SHs.

8. Conclusions

In this paper, a novel method was investigated to properly schedule EVs and ESSs in SHs. The combination of decision vectors and the AHP method was utilized to select the best operation schedule based on the market price, the power of the PVs, and demand. The performance of the proposed method and different priorities of decision criteria were evaluated using economic and technical indices.

Numerical results, obtained from the implementation of the proposed method on a sample SH, show that the management method can properly choose the operation schedule

of the EV and ESS in the SH. When the decision criteria, including market price, PVs, and demand, are considered separately (without the AHP method), the electricity cost of the SH is the lowest when the operation schedule is selected using the decision vectors of the market price, while the peak demand is the lowest when the demand of the SH is only considered. The SH has the best performance when the operational schedules of the EV and ESS are selected using the priorities of demand, PVs, and market prices equal to one, two, and three. According to the results, the charging time of the EV mostly happens during the night, when the market price and demand are low, while the charging time of the ESS mostly happens during midday, when the power of the PVs is available. On the other hand, the ESS can be discharged at the end of the day to reduce the dependence of the SH on the energy of the distribution system. The proposed method has a better performance than another method of energy management, so that the electricity cost and peak demand of the SH are reduced by about 12 and 26% using the proposed method. Moreover, it finds better and more correct results about 99% sooner than the other method. Hence, it can be said that the efficiency of the SH is improved significantly by implementing the proposed energy management in order to select the operation schedule of the EV and ESS in the SH.

Author Contributions: Conceptualization, M.A.; Formal analysis, G.B.G., R.A., A.R. and A.A.-M.; Funding acquisition, A.R. and A.A.-M.; Methodology, M.A.; Resources, R.A., A.R. and A.A.-M.; Software, M.A.; Supervision, G.B.G., R.A. and A.R.; Writing—original draft, M.A.; Writing—review & editing, G.B.G., R.A., A.R. and A.A.-M. All authors have read and agreed to the published version of the manuscript.

Funding: This work was supported in part by the Estonian Research Council under Grant PSG739, by the European Commission through the H2020 project Finest Twins (grant No. 856602) and by the Estonian Ministry of Education and Research and European Regional Fund (grant 2014-2020.4.01.20-0289). Amjad Anvari-Moghaddam acknowledges the support of the MARGIN project funded by the Danida Fellowship Centre and the Ministry of Foreign Affairs of Denmark to research in growth and transition countries under the grant no. 21-M06-AAU.

Conflicts of Interest: The authors declare no conflict of interest.

References

1. Teng, F.; Ding, Z.; Hu, Z.; Sarikprueck, P. Technical review on advanced approaches for electric vehicle charging demand management, part i: Applications in electric power market and renewable energy integration. *IEEE Trans. Ind. Appl.* **2020**, *56*, 5684–5694. [[CrossRef](#)]
2. Zolfaghari, M.; Gharehpetian, G.B.; Shafiekhah, M.; Catalão, J. Comprehensive review on the strategies for controlling the interconnection of AC and DC microgrids. *Int. J. Electr. Power Energy Syst.* **2022**, *136*, 107742. [[CrossRef](#)]
3. Arani, A.; Karami, H.; Gharehpetian, G.B.; Hejazi, M. Review of Flywheel Energy Storage Systems structures and applications in power systems and microgrids. *Renew. Sustain. Energy Rev.* **2017**, *69*, 9–18. [[CrossRef](#)]
4. Hussain, S.; El-Bayeh, C.; Chunyan Lai, C.; Eicker, U. Multi-level energy management systems toward a smarter grid: A review. *IEEE Access* **2021**, *9*, 71994–72016. [[CrossRef](#)]
5. Nizami, M.; Hossain, M.; Mahmud, K. A coordinated electric vehicle management system for grid-support services in residential networks. *IEEE Syst. J.* **2021**, *15*, 2066–2077. [[CrossRef](#)]
6. Alilou, M.; Tousi, B.; Shayeghi, H. Home energy management in a residential smart micro grid under stochastic penetration of solar panels and electric vehicles. *Sol. Energy* **2020**, *212*, 6–18. [[CrossRef](#)]
7. Shin, M.; Choi, D.; Kim, J. Cooperative management for PV/ESS-enabled electric vehicle charging stations: A multiagent deep reinforcement learning approach. *IEEE Trans. Ind. Inform.* **2020**, *16*, 3493–3503. [[CrossRef](#)]
8. Zieglera, D.; Abdelkafi, N. Business models for electric vehicles: Literature review and key insights. *J. Clean. Prod.* **2022**, *330*, 129803. [[CrossRef](#)]
9. Verma, S.; Mishra, H.; Gaur, A.; Chowdhury, S.; Mohapatra, S.; Dwivedi, G.; Verma, P. A comprehensive review on energy storage in hybrid electric vehicle. *J. Traffic Transp. Eng.* **2021**, *8*, 621–637. [[CrossRef](#)]
10. Yang, X.; Zhang, Y. A comprehensive review on electric vehicles integrated in virtual power plants. *Sustain. Energy Technol. Assess.* **2021**, *48*, 101678. [[CrossRef](#)]
11. Kucukoglu, I.; Dewil, R.; Cattrysse, D. The electric vehicle routing problem and its variations: A literature review. *Comput. Ind. Eng.* **2021**, *161*, 107650. [[CrossRef](#)]
12. Kajanova, M.; Bracinik, P. Social welfare-based charging of electric vehicles in the microgrids fed by renewables. *Int. J. Electr. Power Energy Syst.* **2022**, *138*, 107974. [[CrossRef](#)]

13. Zhao, G.; Baker, J. Effects on environmental impacts of introducing electric vehicle batteries as storage—A case study of the United Kingdom. *Energy Strategy Rev.* **2022**, *40*, 100819. [[CrossRef](#)]
14. Zhong, J.; Yang, N.; Zhang, X.; Liu, J. A fast-charging navigation strategy for electric vehicles considering user time utility differences. *Sustain. Energy Grids Netw.* **2022**, *30*, 100646. [[CrossRef](#)]
15. Khamesipour, M.; Chitsaza, I.; Salehib, M.; Alizadenia, S. Component sizing of a series hybrid electric vehicle through artificial neural network. *Energy Convers. Manag.* **2022**, *154*, 115300. [[CrossRef](#)]
16. Guo, Y.; Yousefi, A. Determining the appropriate size of the electrical energy storage system of an energy process based on a solid oxide fuel cell and wind turbine. *J. Energy Storage* **2021**, *44*, 103430. [[CrossRef](#)]
17. He, Y.; Guo, S.; Zhou, J.; Song, G.; Kurban, A.; Wang, H. The multi-stage framework for optimal sizing and operation of hybrid electrical-thermal energy storage system. *Energy* **2022**, *245*, 123248. [[CrossRef](#)]
18. Mehrjerdi, H.; Rakhshani, E. Optimal operation of hybrid electrical and thermal energy storage systems under uncertain loading condition. *Appl. Therm. Eng.* **2019**, *160*, 114094. [[CrossRef](#)]
19. Khan, S.; Wazeer, I.; Almutairi, Z.; Alanazi, M. Techno-economic analysis of solar photovoltaic powered electrical energy storage (EES) system. *Alex. Eng. J.* **2022**, *61*, 6739–6753. [[CrossRef](#)]
20. Nazari, M.; Bagheri-Sanjareh, M.; Hosseinian, S. A new method for energy management of residential microgrid for sizing electrical and thermal storage systems. *Sustain. Cities Soc.* **2022**, *76*, 103482. [[CrossRef](#)]
21. Badar, A.; Anvari-Moghaddam, A. Smart home energy management system—A review. *Adv. Build. Energy Res.* **2022**, *16*, 118–143. [[CrossRef](#)]
22. Bagheri Tookanlou, M.; Pourmousavi-Kani, S.; Marzband, M. A comprehensive day-ahead scheduling strategy for electric vehicles operation. *Int. J. Electr. Power Energy Syst.* **2021**, *131*, 106912. [[CrossRef](#)]
23. Varzaneh, S.; Raziabadi, A.; Hosseinzadeh, M.; Sanjari, M. Optimal energy management for PV-integrated residential systems including energy storage system. *IET Renew. Power Gener.* **2021**, *15*, 17–29. [[CrossRef](#)]
24. Wu, X.; Hu, X.; Yin, X.; Moura, S. Stochastic Optimal energy management of smart home with PEV energy storage. *IEEE Trans. Smart Grid* **2018**, *9*, 2065–2075. [[CrossRef](#)]
25. Mohammad, A.; Zuhaib, M.; Ashraf, I. An optimal home energy management system with integration of renewable energy and energy storage with home to grid capability. *Int. J. Energy Res.* **2022**, *46*, 8352–8366. [[CrossRef](#)]
26. Mohammad, A.; Zuhaib, M.; Ashraf, I.; Alsultan, M.; Ahmad, S.; Sarwar, A.; Mali Abdollahian, M. Integration of electric vehicles and energy storage system in home energy management system with home to grid capability. *Energies* **2021**, *14*, 8557. [[CrossRef](#)]
27. Hussain, H.; Javaid, N.; Iqbal, S.; Hasan, Q.; Aurangze, K.; Alhussein, M. An efficient demand side management system with a new optimized home energy management controller in smart grid. *Energies* **2018**, *11*, 190. [[CrossRef](#)]
28. Igualada, L.; Corchero, C.; Cruz-Zambrano, M.; Heredia, F. Optimal energy management for a residential microgrid including a vehicle-to-grid system. *IEEE Trans. Smart Grid* **2014**, *5*, 2163–2172. [[CrossRef](#)]
29. Mansouri, S.; Nematbakhsh, E.; Ahmarinejad, A.; Jordehi, A.; Javadi, M.; Marzband, M. A hierarchical scheduling framework for resilience enhancement of decentralized renewable-based microgrids considering proactive actions and mobile units. *Renew. Sustain. Energy Rev.* **2022**, *168*, 112854. [[CrossRef](#)]
30. Mansouri, S.; Nematbakhsh, E.; Jordehi, A.; Tostado-Véliz, M.; Jurado, F.; Leonowicz, Z. A risk-based bi-level bidding system to manage day-ahead electricity market and scheduling of interconnected microgrids in the presence of smart homes. In Proceedings of the 2022 IEEE International Conference on Environment and Electrical Engineering and 2022 IEEE Industrial and Commercial Power Systems Europe, Prague, Czech Republic, 28 June–1 July 2022.
31. Mansouri, S.; Ahmarinejad, A.; Nematbakhsh, E.; Javadi, M.; Nezhad, A.; Catalãd, J. A sustainable framework for multi-microgrids energy management in automated distribution network by considering smart homes and high penetration of renewable energy resources. *Energy* **2022**, *245*, 123228. [[CrossRef](#)]
32. Poursmaeil, B.; Najmi, P.; Ravadanegh, S. Interconnected-energy hubs robust energy management and scheduling in the presence of electric vehicles considering uncertainties. *J. Clean. Prod.* **2021**, *316*, 128167. [[CrossRef](#)]
33. Mansouri, S.; Ahmarinejad, A.; Sheidaei, F.; Javadi, M.; Jordehi, A.; Nezhad, A.; Catalãd, J. A multi-stage joint planning and operation model for energy hubs considering integrated demand response programs. *Int. J. Electr. Power Energy Syst.* **2022**, *140*, 108103. [[CrossRef](#)]
34. Mansouri, S.; Nematbakhsh, E.; Ahmarinejad, A.; Jordehi, A.; Javadi, M.; Matin, S. A Multi-objective dynamic framework for design of energy hub by considering energy storage system, power-to-gas technology and integrated demand response program. *J. Energy Storage* **2022**, *50*, 104206. [[CrossRef](#)]
35. Powell, S.; Cezar, G.; Apostolaki-Iosifidou, E.; Rajagopal, R. Large-scale scenarios of electric vehicle charging with a data-driven model of control. *Energy* **2022**, *248*, 123592. [[CrossRef](#)]
36. Alilou, M.; Tousi, B.; Shayeghi, H. Multi-objective energy management of smart homes considering uncertainty in wind power forecasting. *Electr. Eng.* **2021**, *103*, 1367–1383. [[CrossRef](#)]
37. Santos, P.; Neves, S.; Anna, D.; Oliveira, S.; Carvalho, H. The analytic hierarchy process supporting decision making for sustainable development: An overview of applications. *J. Clean. Prod.* **2019**, *212*, 119–138. [[CrossRef](#)]
38. Zamanloo, S.; Abyaneh, H.; Nafisi, H.; Azizi, M. Optimal two-level active and reactive energy management of residential appliances in smart homes. *Sustain. Cities Soc.* **2021**, *71*, 102972. [[CrossRef](#)]

39. Casaran, J.; Echeverry, D.; Lozano, C. Demand response integration in microgrid planning as a strategy for energy transition in power systems. *IET Renew. Power Gener.* **2021**, *15*, 889–902. [[CrossRef](#)]
40. Akbari, H.; Browne, M.; Ortega, A.; Huang, M.; Hewitt, N.; Norton, B.; McCormack, B. Efficient energy storage technologies for photovoltaic systems. *Sol. Energy* **2019**, *192*, 144–168. [[CrossRef](#)]
41. Shafiekhah, M.; Siano, P.; Fitiwi, D.; Mahmoudi, N.; Catalão, J. An innovative two-level model for electric vehicle parking lots in distribution systems with renewable energy. *IEEE Trans. Smart Grid* **2017**, *9*, 1506–1520. [[CrossRef](#)]